

PAL

No. DZ20227621

TEST REPORT

SAMPLE NAME iMeter 8
CLIENT CET Electric Technology Inc.
MANUFACTURER CET Electric Technology Inc.
TEST TYPE Commission Test

Experiment and Verification Center, State Grid
Electric Power Research Institute



SUMMARY OF THE REPORT


Test type	Commission test	Sample type	iMeter 8
		Sample name	/
Client	CET Electric Technology Inc.	Registered address of client	8/F, Westside, Building 201, Terra Industrial & Tradepark, Che Gong Miao, Shenzhen, Guangdong 518040, China
Manufacturer	CET Electric Technology Inc.	Registered address of manufacturer	8/F, Westside, Building 201, Terra Industrial & Tradepark, Che Gong Miao, Shenzhen, Guangdong 518040, China
Quantity of sample	1	Sample No.	DZ20227621
Receipt date of sample	2023.02.14	Condition of sample	Intactness
Software version	/	Check code	/
Test date(s)	2023.02.14 to 2023.03.17		
Test location(s)	No. 19 Chengxin Avenue, Jiangning District, Nanjing, China		
Test standard(s)	<p>IEC 61000-4-30 Ed.3.1 (2021) "Electromagnetic compatibility (EMC)-Part 4-30: Testing and measurement techniques-Power quality measurement methods"</p> <p>IEC 62586-2 Ed.2.1 (2021) "Power quality measurement in power supply systems-Part 2: Functional tests and uncertainty requirements"</p> <p>IEC 61000-4-15 Ed.2.0 (2010) "Electromagnetic compatibility (EMC)-Part 4-15: Testing and measurement techniques-Flickermeter-Functional and design specifications"</p> <p>IEC 61000-4-7 Ed.2.1 (2009) "Electromagnetic compatibility (EMC)-Part 4-7: Testing and techniques-General guide on harmonics and interharmonics measurement measurements and instrumentation, for power supply systems and equipment connected thereto"</p> <p>IEC 61000-2-4 Ed.2.0 (2002) "Electromagnetic compatibility (EMC)-Part 2-4: Environment-Compatibility levels in industrial plants for low-frequency conducted disturbances"</p>		
Conclusion	The sample of CET Electric Technology Inc.: iMeter 8 Advanced Power Quality Analyzer, after quality inspection, the results meet the requirements of test standards.		
Issued by	Wan Dechun	Issue date	2023.3.29
Note	/		

Sample photos

1. Front



2. Back

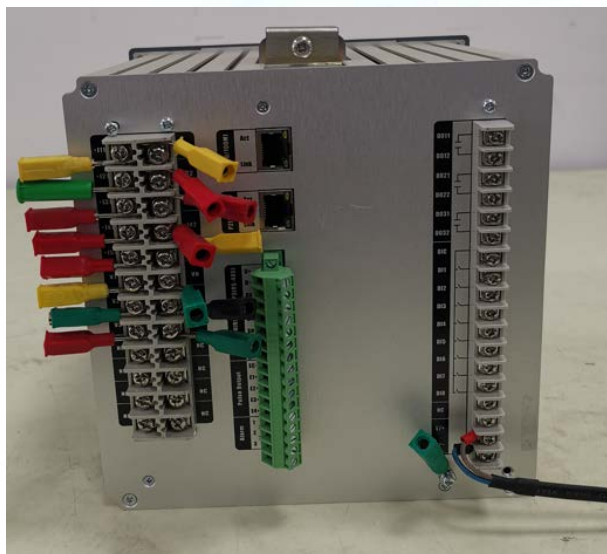


Contents

1 Power Frequency (Class A).....	9
1.1 Measurement method.....	9
1.2 Measurement uncertainty and measuring range.....	9
1.3 Measurement evaluation.....	12
2 Magnitude of Supply Voltage (Class A).....	12
2.1 Measurement method.....	12
2.2 Measurement uncertainty and measuring range.....	13
2.3 Measurement aggregation.....	15
3 Flicker (Class A).....	17
3.1 Sinusoidal / rectangular voltage changes.....	17
3.2 Rectangular voltage changes and performance testing.....	19
3.3 Combined frequency and voltage changes.....	20
3.4 Distorted voltage with multiple zero crossings.....	21
3.5 Bandwidth testing using harmonic and inter-harmonic side band modulation.....	21
3.6 Phase jumps.....	22
3.7 Rectangular voltage changes with 20% duty cycle.....	22
3.8 Verify flicker Plt aggregation.....	23
4 Supply Voltage Interruptions, Dips and Swells (Class A).....	23
4.1 General.....	23
4.2 Check dips / interruptions in polyphase system.....	27
4.3 Check Swells in polyphase system.....	29
5 Supply Voltage Unbalance (Class A).....	32
5.1 General.....	32
5.2 Measurement method, measurement uncertainty and measuring range.....	32
5.3 Aggregation.....	33
6 Voltage Harmonics (Class A).....	34
6.1 Measurement method.....	34
6.2 Measurement uncertainty and measuring range.....	39
6.3 Measurement aggregation.....	41
7 Voltage Interharmonics (Class A).....	44
7.1 Measurement method.....	44
7.2 Measurement uncertainty and measuring range.....	46
7.3 Measurement aggregation.....	50
8 Mains signaling voltages on the supply voltage (Class A).....	53
8.1 Measurement method.....	53
8.2 Measurement uncertainty and measuring range.....	59
9 Measurement of Underdeviation and Overdeviation Parameters (Class A).....	68
9.1 Measurement method.....	68

9.2 Measurement uncertainty and measuring range	73
9.3 Measurement aggregation	73
10 Flagging (Class A)	80
10.1 Check flagging is not set when flagging conditions are not met	80
10.2 Flagging in polyphase system caused by voltage dip (For Plt flicker).....	80
10.3 Flagging in polyphase system caused by voltage dip (for parameters other than Plt)	81
10.4 Flagging in polyphase system caused by voltage swell	82
10.5 Flagging in polyphase system caused by voltage interruption	83
11 Clock Uncertainty (Class A)	84
11.1 Check Clock Uncertainty	84
12 Rapid Voltage Change (RVC) (Class A)	85
12.1 RVC parameters and evaluation.....	85
12.2 General	85
12.3 "No RVC" tests.....	86
12.4 "RVC threshold and setup" test.....	88
12.5 "RVC parameters" test	89
12.6 "RVC polyphase" test	90
12.7 Voltage is in steady-state condition" tests	91
13 Magnitude of Current (Class A)	92
13.1 Measurement method.....	93
13.2 Measurement uncertainty and measuring range.....	93
13.3 Measurement aggregation	95
14 Harmonic currents (Class A).....	97
14.1 Measurement method.....	97
14.2 Measurement uncertainty and measuring range.....	102
14.3 Measurement aggregation	104
15 Interharmonic currents (Class A)	107
15.1 Measurement method.....	107
15.2 Measurement uncertainty and measuring range.....	109
15.3 Measurement aggregation	111
16 Current Unbalance (Class A).....	114
16.1 General	114
16.2 Measurement method, measurement uncertainty and measuring range.....	114
17 Conducted emissions in the 2kHz to 150kHz range (Class A)	116
17.1 Measurement method - 2kHz to 9kHz.....	116
17.2 Measurement method - 9kHz to 150kHz	116
17.3 Measurement range and measurement uncertainty	116
17.4 Aggregation	117

SUMMARY OF THE REPORT

Sample type	iMeter 8		Sample name	/	
Quantity of sample	1		Sample No.	DZ20227621	
Receipt date of sample	2023.02.14		Condition of sample	Intactness	
Software version	/		Check code	/	
Test date(s)	2023.02.14 to 2023.03.17				
Test location(s)	No. 19 Chengxin Avenue, Jiangning District, Nanjing, China				
Test standard(s)	<p>IEC 61000-4-30 Ed.3.1 (2021) "Electromagnetic compatibility (EMC)-Part 4-30: Testing and measurement techniques-Power quality measurement methods"</p> <p>IEC 62586-2 Ed.2.1 (2021) "Power quality measurement in power supply systems-Part 2: Functional tests and uncertainty requirements"</p> <p>IEC 61000-4-15 Ed.2.0 (2010) "Electromagnetic compatibility (EMC)-Part 4-15: Testing and measurement techniques-Flickermeter-Functional and design specifications"</p> <p>IEC 61000-4-7 Ed.2.1 (2009) "Electromagnetic compatibility (EMC)-Part 4-7: Testing and techniques-General guide on harmonics and interharmonics measurement measurements and instrumentation, for power supply systems and equipment connected thereto"</p> <p>IEC 61000-2-4 Ed.2.0 (2002) "Electromagnetic compatibility (EMC)-Part 2-4 : Environment-Compatibility levels in industrial plants for low-frequency conducted disturbances"</p>				
Main test instruments: name, type, serial number and expire date					
Relay Protection Tester	CMC256plus	PAL/D-03.0015	2024.03.02		
Standard power source	6100B	PAL/D-09.0011	2023.11.17		
Integrated Relay Protection Tester	ONLY-BQ660	PAL/D-03.0125	2024.03.06		
Digital Multi-function Meter	8846A	PAL/D-03.0164	2024.03.02		
Signal Generator	SMC100A	PAL/F-03.0004	2023.10.10		
Power amplifier	BBA100-A500	PAL/F-03.0011	2023.10.10		
Integrated Time Accuracy Tester	FH-GX	PAL/E-SZ.0007	2024.03.02		
Power Quality Standard Source	PQC700A	PAL/D-09.0010	2023.09.06		
Conclusion	The sample of CET Electric Technology Inc.: iMeter 8 Advanced Power Quality Analyzer, after quality inspection, the results meet the requirements of test standards.				
Tested by	Huang Zheng	Checked by	Jang Peng	Examined by	Cai Dan
					
Note	/				

List of the Test Items

No.	Test items	Conclusions	Notes
1	Power Frequency (Class A)	Measurement method	Pass
		Measurement uncertainty and measuring range	Pass
		Measurement evaluation	Pass
2	Magnitude of Supply Voltage (Class A)	Measurement method	Pass
		Measurement uncertainty and measuring range	Pass
		Measurement aggregation	Pass
3	Flicker (Class A)	Sinusoidal / rectangular voltage changes	Pass
		Rectangular voltage changes and performance testing	Pass
		Combined frequency and voltage changes	Pass
		Distorted voltage with multiple zero crossings	Pass
		Bandwidth test using harmonic and inter-harmonic side band modulation	Pass
		Phase jumps	Pass
		Rectangular voltage changes with 20% duty cycle	Pass
Verify flicker PIt aggregation	Pass		
4	Supply Voltage Interruptions, Dips and Swells (Class A)	General	Pass
		Check dips / interruptions in polyphase system	Pass
		Check swells in polyphase system	Pass
5	Supply Voltage Unbalance (Class A)	General	N/A
		Measurement method, measurement uncertainty and measuring range	Pass
		Aggregation	Pass
6	Voltage Harmonics (Class A)	Measurement method	Pass
		Measurement uncertainty and measuring range	Pass
		Measurement aggregation	Pass
7	Voltage Interharmonics (Class A)	Measurement method	Pass
		Measurement uncertainty and measuring range	Pass
		Measurement aggregation	Pass
8	Mains signaling voltages on the supply voltage (Class A)	Measurement method	Pass
		Measurement uncertainty and measuring range	Pass
9	Measurement of Underdeviation and	Measurement method	Pass
		Measurement uncertainty and measuring range	Pass

No.	Test items		Conclusions	Notes
		Measurement aggregation	Pass	
10	Flagging (Class A)	Check flagging is not set when flagging conditions are not met	Pass	
		Flagging in polyphase system caused by voltage dip (for Plt flicker)	Pass	
		Flagging in polyphase system caused by voltage dip (for parameters other than Plt)	Pass	
		Flagging in polyphase system caused by voltage swell	Pass	
		Flagging in polyphase system caused by voltage interruption	Pass	
11	Clock Uncertainty (Class A)	Check Clock Uncertainty	Pass	
12	Rapid Voltage Changes (RVC) (Class A)	RVC parameters and evaluation	N/A	
		General	N/A	
		"No RVC" tests	Pass	
		"RVC threshold and setup" test	Pass	
		"RVC parameters" test	Pass	
		"RVC polyphase" test	Pass	
13	Magnitude of Current (Class A)	Measurement method	Pass	
		Measurement uncertainty and measuring range	Pass	
		Measurement aggregation	Pass	
14	Harmonic Currents (Class A)	Measurement method	Pass	
		Measurement uncertainty and measuring range	Pass	
		Measurement aggregation	Pass	
15	Interharmonic Currents (Class A)	Measurement method	Pass	
		Measurement uncertainty and measuring range	Pass	
		Measurement aggregation	Pass	
16	Current Unbalance (Class A)	General	N/A	
		Measurement method, measurement uncertainty and measuring range	Pass	
17	Conducted emissions in the 2 kHz to 150 kHz range (Class A)	Measurement method – 2 kHz to 9 kHz	N/A	
		Measurement method – 9 kHz to 150 kHz	N/A	
		Measurement range and measurement uncertainty	Pass	
		Aggregation	Pass	

NOTE:

Test sample does meet the requirement.....: Pass

Test sample does not meet the requirement.....: Fail