



4G<sup>+</sup>



# iMeter D7

DIN Rail Advanced Power  
Quality Analyzer

# iMeter D7



**iMeter D7** is CET's Advanced DIN-Rail Mount PQ Analyzer designed for the compliance monitoring market as it offers un-surpassed functionality by combining Class 0.2S accuracy and advanced PQ features in a compact 145\*124\*77mm housing with a High-Resolution, IPS Color Dot-Matrix Display. The iMeter D7 complies with such standards as IEC62053-22 Class 0.2S, IEC61000-4-30 Ed.3 Class A, IEC61000-4-15, IEC61000-4-7, EN50160, IEEE Std 519-2022 as well as IEC61850 for Substation Automation. Further, it offers a large logging capacity with 4GB of on-board memory, extensive I/O, multiple Time Sync. methods, 2x10/100BaseT Ethernet and 1xRS-485 ports. In addition, it optionally supports wireless connection, 2xAI for measuring external transducer signal or 1xResidual Input & 1xRTD for Leakage Current and Temperature Measurements. These features likely make the iMeter D7 the most advanced DIN-Rail PQ Analyzer for an intelligent Power Quality Monitoring System.

## Typical Applications

- PQ monitoring at LV Utility Substations
- Data Centers, Semiconductor Fabs and Heavy Industries
- 7x24 Automated Manufacturing Facilities
- Mains and Critical Feeder Monitoring
- Renewable Energy Applications
- Dips, Swells, Interruptions, Transients, Flickers and Harmonics monitoring
- IEC61850 support for Substation Automation and Smart Grid
- Retrofit applications with optional Class 0.5S Split-Core Current Probes

## Basic Features

- IEC62053-22 Class 0.2S kWh metering with Multi-Tariff TOU
- True RMS @ 1024 samples/cycle sampling
- 4GB on-board log memory
- High-Resolution IPS Color LCD Display @ 320x240
- Time Sync. via IRIG-B, NTP, IEEE 1588 (PTP), or GPS 1PPS output
- Device Operating Time (Running Hours)
- 64 Programmable Setpoints
- Dual 10/100BaseT Ethernet and one RS-485 ports

## Display & Web Server

The panel display and on-board web server allow complete access to following data and configurations

- True RMS Real-time, Harmonics, Power and Energy Measurements
- Phasor Diagram
- Demands and Multi-Tariff TOU
- Max. & Min. Logs
- Deviation, Sequence & Unbalance
- Real-time WFC of 3-phase U & I @ 128 samples/cycle x 4 cycles
- Event Waveforms, RMS Recording and ITIC/SEMI F47 Curves
- Harmonics & Interharmonics Histogram
- Device and SOE Logs, PQ Counters and I/O Status
- Device Configuration and Diagnostics
- Remote access to Front Panel Display via Web Interface

## Metering

### Basic Measurements (1-second update)

- 3-phase U, I, P, Q, S and PF as well as U4, I4, Ung, Frequency, IR# and optional Ir#

#IR – Calculated Residual Current, Ir – Measured Residual Current

### High-Speed Measurements

- 3-phase U, I, P, Q, S and PF as well as U4 and I4 @ ½ cycle
- Frequency @ 5 cycle

### Energy

- Per-phase kWh, kvarh Import/Export/Net/Total and kVAh Total
- Total RMS kWh, kvarh Import/Export/Net/Total and kVAh Total
- Total Fundamental kWh, kvarh Import/Export/Net/Total
- Total Harmonic kWh, kvarh Import/Export/Net/Total
- Total Harmonic kWh, kvarh Import/Export from 2<sup>nd</sup> to 63<sup>rd</sup>

### Demands

- Present and Predicted Demand for 3-phase U, I, P, Q, S, PF as well as U4, I4, Frequency
- Present Demand of 4-phase U & I THD/TOHD/TEHD, 4-phase Current K-Factor, U & I Unbalance, Over Deviation & Under Deviation of Voltage and Frequency, 4-phase Fundamental Current
- Maximum Demands for This Month & Last Month (or Since Last Reset & Before Last Reset)
- Max./Min. values per Demand Interval
- Demand Synchronization with DI

# Advanced Power

## Multi-Tariff TOU Capability

- Two independent sets of TOU Schedules
  - Up to 12 Seasons
  - 90 Holidays or Alternate Days and 3 Weekdays
  - 20 Daily Profiles, each with 12 Periods in 15min intervals
  - 8 Tariffs, each providing the following information:
    - kWh/kvarh Import/Export and kVAh
    - P & Q Import/Export Maximum Demands
    - Register rollover at 100,000,000,000.000 kXh
- Switching between two TOU schedules manually or according to pre-programmed time
- 12 Historical Logs for Energy and Max. Demand

## Power Quality Metering

### PQ Parameters as per IEC61000-4-30 Ed.3 Class A

- Power Frequency
- Magnitude of the Supply Voltage
- Flicker
- Supply Voltage Dips, Swells and Interruptions
- Supply Voltage Unbalance
- Voltage Harmonics and Interharmonics
- Mains Signalling Voltage on the Supply Voltage
- Rapid Voltage Changes
- Measurement of Over Deviation and Under Deviation Parameters
- Magnitude of Current
- Current Harmonics and Interharmonics
- Current Unbalance
- 2kHz to 150kHz Conducted Emission Measurements

### Harmonic and Interharmonic Measurements

- K-Factor for Current, Crest Factor for Current and Voltage
- U and I THD, TOHD, TEHD, TIHD, TOIHD, TEIHD and TH (RMS)
- U and I Individual Harmonics (%HD and RMS) from 2<sup>nd</sup> to 63<sup>rd</sup>#
- U and I Individual Interharmonics (%IHD and RMS) from 1<sup>st</sup> to 63<sup>rd</sup>#
- Total Harmonic P, Q, S and PF
- Harmonic P, Q, S and PF from 2<sup>nd</sup> to 63<sup>rd</sup> in RMS
- Fundamental U, I, P, Q, S, Phase Angle and Displacement PF
- Harmonic Phase Angle from 2<sup>nd</sup> to 63<sup>rd</sup>
- U and I DC Components

# %HD and %IHD can be configured as % of Fundamental, % of U/I nominal or % of RMS

### Conducted Emissions in the 2kHz to 150kHz Range

- Real-time amplitude (150/180-cycle) and the Max., Min., Avg. and 95<sup>th</sup> percentile values (in 1-min interval) for Voltage channels with a total of 106 frequency segments (2kHz - 150kHz range) and Current channels with a total of 35 frequency segments (2kHz - 9kHz range)
- Daily Heat Map display on the Web Interface for the Max., Min., Avg. and 95<sup>th</sup> percentile values

### Sequence and Unbalance

- Zero, Positive and Negative Sequence Components
- U and I Unbalance based on Zero and Negative Sequence Components

### Dips, Swells, Interruptions Recording

- Dips, Swells and Interruptions detection @ 10ms (½ cycle at 50Hz)
- Trigger for DO, SOE Log, DR, WFR, DWR, RMSR, iTrigger and Alarm Email
- Configurable DO trigger for the Start or End of a PQ disturbance
- Display of Event specific WFR, DWR and/or RMSR as well as the associated ITIC/SEMI F47 plot on the Front Panel and Web Interface
- ITIC/SEMI F47 Alarm trigger for DO and iTrigger upon the detection of PQ Disturbances that are outside of the respective tolerance curves

### Transients Recording

- Transients capture as short as 20us @ 50Hz or 16.67us @ 60Hz at 1024 samples for sub-cycle disturbances such as capacitor switching and resonance phenomena
- Trigger for DO, SOE Log, WFR, DWR, RMSR, iTrigger and Alarm Email
- Display of Event specific WFR, DWR and/or RMSR on the Front Panel and Web Interface

### Rapid Voltage Changes (RVC)

- Detection of a quick transition in RMS voltage between two steady-states

### Inrush Current Monitoring

- Monitoring of the ½ cycle RMS Current and capturing of the Current waveforms associated with events such as motor starting and transformer being energized

### Disturbance Direction Indicator

- Determine if a Dip/Swell/Interruption Event is located upstream or downstream
- Pinpoint if the cause of the event is external or internal

### PQ Event Counters

- Dips, Swells, Interruptions, Transients, Rapid Voltage Changes, Inrush Currents, Mains Signalling Voltages and Total PQ Event Counters

### Real-Time Waveform Capture (WFC) and Waveform Recorder (WFR)

- Real-time WF Capture @ 128 samples/cycle x 4 cycles
- WFR with max. 128 entries
- Simultaneous capture of 4-phase Voltage and Current Inputs
- (Range of Cycles) x Samples/Cycles with programmable pre-fault and post-fault cycles: (40-400) x1024, (40-800) x512, (40-1600) x256, (40-3200) x128
- Scheduled WFR with max. repetition of 10,000 times and programmable schedule from 1 to 65535 min.
- COMTRADE file format, downloadable from the on-board Web Server or FTPS Server

### Disturbance Waveform Recorder (DWR)

- 128 entries
- Simultaneous recording of all Voltage (U1-U4) and Current (I1-I4) Inputs
  - Initial Fault: 35 cycles @ 512 samples/cycle
  - Extended Fault: Up to 150 cycles @ 16 samples/cycle
  - Steady State: Up to 360s of 1-cycle absolute peak values
  - Post Fault: 15 cycles @ 512 samples/cycle

### RMS Recorder (RMSR)

- 128 entries
- 16 channels max., selectable U, I, P, Q, S, PF, Frequency, Freq. Deviation
- Recording Interval from 0.5 to 60 cycles
- Recording Width @ 7200 samples per parameter
- Configurable pre-fault samples from 100 to 500
- 72 seconds of ½ cycle RMS recording @ 50Hz or 60 seconds @ 60Hz

# Quality Analyzer



## Power Quality Features

- IEC61000-4-30 Ed. 3 Class A Certified
- EN50160 and IEEE Std 519-2022 Reporting
- 2kHz to 150kHz Conducted Emission Measurements
- Dips, Swells, Interruptions, Transients, Rapid Voltage Changes, Inrush Current, Mains Signalling Voltage and Flicker monitoring
- Real-time Waveform Capture (WFC), Waveform Recording (WFR) & Disturbance Waveform Recording (DWR)
- Disturbance Direction Indicator for Dips, Swells and Interruptions
- Statistical Data Recording and ½ cycle RMS Recording
- Fault Capture up to 2,000V peak to peak (400V<sub>LN</sub> Input)
- Waveform Recording in COMTRADE file format

## Data and Event Recorders

### Non-Volatile Log Memory

- 4GB on-board Log Memory

### Device Log

- 1024 FIFO entries time-stamped to ±1ms resolution
- Power On/Off, Setup changes, Time Sync., Device Operations and Self-diagnostics

### Interval Energy Recorder (IER) and Accumulative Energy Recorder (AER)

- Both IER Log and AER Log support the recording of per-phase and Total RMS kWh, kvarh Import/Export/Net/Total and kVAh Total, Total Fundamental and Total Harmonic kWh, kvarh Import/Export
- Recording Interval from 1 minute to 65535 minutes
- Max. Recording Depth @ 65535 records
- Support FIFO and Stop-When-Full mode

### Statistical Data Recorder (SDR)

- 8 SDR Logs of max. 64 parameters each
- Recording of the Max., Min., Avg. and 95<sup>th</sup> percentile values for real-time measurements including U, I, Freq., P, Q, S, PF, Harmonics, Deviations and Unbalances
- Recording interval from 1 to 60 minutes
- 90 days @ 3-minute, 300 days @ 10-minute, 450-day @ 15-minute
- Downloadable via Free software
- Support FIFO or Stop-When-Full mode

### Data Recorder

- 8 DR Logs of max. 64 parameters each
- RMS/Fundamental/Harmonic/Interharmonic Measurements, Demands, Deviations, MSV, Unbalances and Flicker
- Configurable Recording Offset and Interval from 1s to 40 days
- Max. Recording Depth @ 65535 records
- Support FIFO or Stop-When-Full mode

### Max./Min. Recorder (MMR)


- 4 Max./Min. Recorders of 20 parameters each
- RMS/Fundamental/Harmonic/Interharmonic Measurements, Demands, Deviations, Mains Signalling Voltages, Unbalances and Flicker
- Two transfer modes:
  - Manual: Max./Min. Since Last Reset & Before Last Reset
  - Auto: Max./Min. of This Month & Last Month

### SOE Log

- 1024 FIFO events time-stamped to ±1ms resolution
- Setpoint event, I/O operation, Dip, Swell, Interruption, Transient, Rapid Voltage Change, Inrush Current, Mains Signalling Voltage, Motor Start, iTrigger, etc.
- Record the characteristic data for Setpoint events as well as WFR, DWR, RMSR, ITIC and SEMI F47 Curve for PQ events

### IEEE Std 519-2022 Report

- 365 Daily Reports for statistical evaluations on Voltage and Current Harmonics based on 99<sup>th</sup> percentile very short time (3 s) values
- 52 Weekly Reports for statistical evaluations on Voltage Harmonics (95<sup>th</sup> percentile) and Current Harmonics (95<sup>th</sup> and 99<sup>th</sup> percentile) short time (10 min) values
- Programmable settings for Report Mode, PCC Voltage, Max. Short Circuit Current, etc.

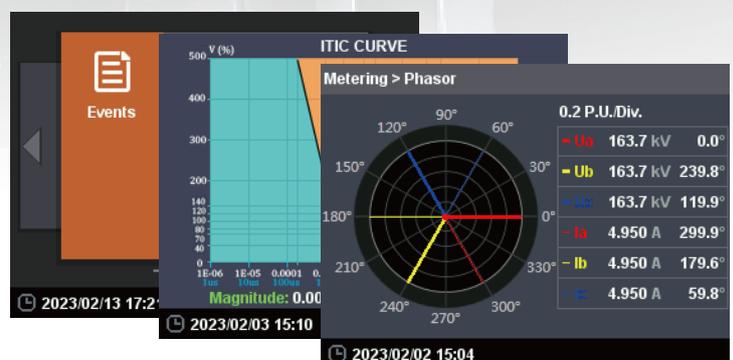

# iMeter D7

## iTrigger

- Cross trigger DO, SOE Log, WFR, DWR, RMSR and Alarm Email with other iMeter devices within the same local area network (LAN)
- Provides Group ID and MAC Address as the trigger source

## Setpoints

### PQ Setpoints

- Transients, Dips, Swells, Interruptions, ITIC Alarm, SEMI F47 Alarm
- Rapid Voltage Changes, Inrush Current
- Trigger DO, DR, SOE Log, WFR, DWR, RMSR, iTrigger and Alarm Email

### Motor Start Setpoint

- Monitoring motor startup procedure with recording of Max. Starting Current, Minimum Voltage and Duration
- Trigger DO, SOE Log, WFR, DWR, RMSR, iTrigger and Alarm Email

### Control Setpoints

- 64 Control Setpoints can be configured with extensive monitoring sources including U, I, P, Q, S, Demands, Harmonics, Unbalances, Deviations, Flickers, Phase Reversal/Loss, Ir and AI, etc.
- Configurable thresholds and time delays
- Trigger DO, DR, SOE Log, WFR, DWR, RMSR, iTrigger and Alarm Email

### Digital Input Setpoints

- Provides Control Output Actions in response to DI status changes
- Trigger DO, DR, SOE Log, WFR, DWR, RMSR, iTrigger and Alarm Email

## Inputs and Outputs

### Digital Inputs


- Standard 4 channels, volt free dry contact, 24VDC Internal Excitation
- 1000Hz sampling for status monitoring with programmable debounce
- Pulse counting with programmable weight for each channel for collecting WAGES (Water, Air, Gas, Electricity, Steam) information
- Demand Synchronization and Tariff Switching based on DI Status

### Digital Outputs

- Optional 2xAI, 0/4-20mA DC input with programmable zero and full scales that can be used to measure external transducer signal
- Optional 3 SS Relays for Energy pulsing applications

### Analog Inputs (Optional)

- Optional 2xAI, 0/4-20mA DC Input with programmable zero and full scales that can be used to measure external transducer signal
- Optional 1xResidual Input for Leakage Current & 1xRTD for Temperature Measurements (Residual Current Transducer and PT100 Sensor not included)

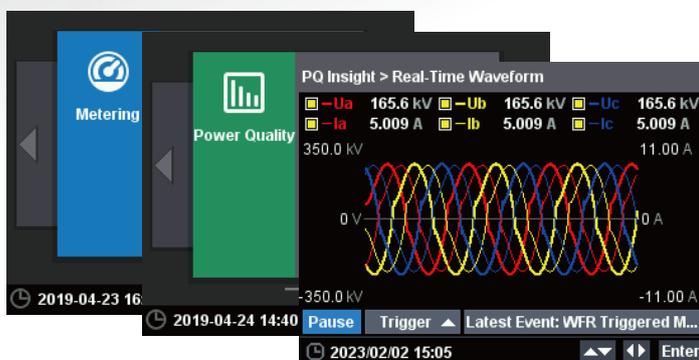

## Communications

### Ethernet Ports (P1, P2)

- Dual 10/100BaseT Ethernet Ports with RJ45 connector
- Selectable IP Addressing Mode – DHCP and Static
- White List for Client Access Control
- Protocols supported: Modbus TCP, HTTPS, NTP, SMTPS, SNMP, FTPS, MQTT, IPsecVPN and IEC61850
- Built-in password protected Web Server with multiple user accounts and pre-defined roles for easy data viewing, setup configuration and firmware upgrade
- Simultaneous client connections for 12xModbus TCP and 4xIEC61850

### RS-485

- One optically isolated RS-485 port with Baud Rate from 1.2 to 38.4 kbps
- Support Modbus RTU and Ethernet Gateway

### 4G (Optional)

- Optionally equipped with Built-in 4G LTE CAT4 modem
- Frequency bands supported#:
  - 4G LTE: B1/B3/B5/B7/B8/B20/B28/B38/B40/B41
  - 3G DC-HSPA+/HSPA/UMTS: B1/B5/B8
  - 2G GSM: 900/1800 MHz

#Availability and supported carrier vary by region

## Time Synchronization

- Battery-backed Real-time clock @ 6ppm ( $\leq 0.5s/day$ )
- Time Sync. with auto-selection among Modbus RTU, NTP, GPS 1PPS, IRIG-B or IEEE 1588 (PTP)

## System Integration

### iPQ Explore

- Display of Real-time Measurements, PQ Events, Waveforms and Statistical Trend charts
- Export of IER, AER and SDR Logs as well as EN50160 Reports
- Generation and export of self-defined PQ Analysis Reports

### System Integration

- The iMeter D7 is supported by CET's PecStar® iEMS
- Easy integration into 3<sup>rd</sup> party Substation Automation or Utility SCADA systems via Modbus RTU, Modbus TCP or IEC61850
- The on-board, password protected Web Server provides user-friendly access to its data and supports the configuration for most Setup parameters via a web browser without the use of proprietary software
- The on-board, password protected FTPS Server allows Excel files for the logged C.E. Measurement data, IEEE Std 519-2022 Daily and Weekly reports and waveform records in COMTRADE format to be downloaded without any special software
- The downloaded files can be subsequently viewed using software that supports these industry standard file formats

# Accuracy

Parameters	Accuracy		Resolution
Voltage (U)	5A/1A	±0.1%	0.001V
I1, I2, I3, I4	5A/1A	±0.1%	0.001A
	SCCT/SCCTA	±0.1%+Error of SCCT	
	SCCPA	±0.1%+Error of SCCP	
P, Q, S	5A/1A	±0.2%	0.001W/var/VA
	SCCT/SCCTA	±0.5%	
	SCCPA	±0.5%	
kWh, kVAh	5A/1A	IEC62053-22 Class 0.2S	0.1kWh
	SCCT/SCCTA	IEC62053-21 Class 1	
	SCCPA	IEC62053-22 Class 0.5S	
kvarh	5A/1A	IEC62053-24 Class 0.5S IEC62053-23 Class 2	0.1kvarh
	SCCT/SCCTA	IEC62053-24 Class 1 IEC62053-23 Class 2	
	SCCPA	IEC62053-24 Class 1 IEC62053-23 Class 2	
PF	5A/1A	±0.2%	0.001
	SCCT/SCCTA	±0.5%	
	SCCPA	±0.5%	
Fundamental Phase Angle	5A/1A	±0.2°	0.1°
	SCCT/SCCTA	±0.2°+Phase Error of SCCT	
	SCCPA	±0.2°+Phase Error of SCCP	
Harmonics Phase Angle	5A/1A	±5°	0.1°
	SCCT/SCCTA	±5°+Phase Error of SCCT	
	SCCPA	±5°+Phase Error of SCCP	
Freq., Freq. Dev.	±0.003Hz		0.001Hz
Harmonics	IEC61000-4-7 Class I		0.01%
U Deviation	±0.1%		0.01%
U Unbalance	±0.1%		0.01%
I Unbalance	±0.5%		0.01%
Pst, Plt	IEC61000-4-15 Class F1		0.001

Current Inputs (I11, I12, I21, I22, I31, I32, I41, I42)		
Standard (In)	5A (1A Optional)	
Range	1% to 400% In	
Starting Current	0.1% In	
Overload	4xIn continuous, 10xIn for 1s	
Burden	< 0.5VA/per phase @ 5A	
	< 0.1VA/per phase @ 1A	
CT Ratio	Primary	1-30,000A
	Secondary	1-50A
	I4 Primary	1-30,000A
	I4 Secondary	1-50A
SCCP Options	SCCP-50A-500mV	5A/50A (In/Imax), max. 500mV Output
	SCCP-200A-200mV	20A/200A (In/Imax), max. 200mV Output
	SCCP-500A-500mV	500A Imax, max. 500mV Output
	SCCP-5000A-500mV	Selectable 500A/5000A (Imax) Rogowski Coil, max. 500mV Output
SCCT Options	PMC-SCCT-100A-40mA-16-A, Ø=16mm, Class 0.5	
	PMC-SCCT-200A-40mA-24-A, Ø=24mm, Class 0.5	
	PMC-SCCT-400A-40mA-35-A, Ø=35mm, Class 0.5	
	PMC-SCCT-800A-40mA-A, 80x50mm, Class 0.5	
	PMC-SCCT-1600A-40mA-A, 130x55mm, Class 0.5	
SCCTA Option	Class 1 Split-Core CT Input @ 2mA (Available Option: 5A only)	

Optional Pulse Outputs (E1+, E1-, E2+, E2-, E3+, E3-)	
Type	Form A Solid State Relay
Isolation	Optical
Max. Load Voltage	30VDC
Max. Forward Current	100mA

Optional Analog Input (AI1+, AI1-, AI2+, AI2-)	
Type	0-20/4-20 mA DC
Overload	24 mA maximum

Optional Residual Current Input (-IR, IR)	
In	0.5 mA
Range	2-200%In

Optional RTD Temperature Inputs (TC11, TC12)	
RTD Type	2-Wire PT100 (sensor not included)
Range	-40°C to +200°C
Accuracy	±1°C

Clock Input (CLK+, CLK-)	
Type	GPS, IRIG-B
Accuracy	1ms

Terminals Max. Torque	
Current Inputs	1.0 N·m
Power Supply, Voltage Inputs, DI, DO, AI, IR, TC, CLK & RS-485	0.44 N·m

Environmental Conditions	
Operating Temperature	-25°C to 70°C
Storage Temperature	-40°C to 85°C
Humidity	5% to 95% non-condensing
Atmospheric Pressure	63 kPa to 110 kPa
Pollution Degree	2

Mechanical Characteristics	
Mounting	35mm DIN Rail
Unit Dimensions	144.8×115.8×75.6 mm
IP Rating	30

# Technical Specifications

Voltage Inputs (V1, V2, V3, VN, V4, V4N)		
Standard (Un)	400VLN/690VLL+ 20%	
Range	5V to 2Un for 400VLN nominal	
Overload	2xUn continuous, 4xUn for 1s	
Burden	< 0.5VA/per phase	
PT Ratio	Primary	1-1,000,000V
	Secondary	1-1,500V
	V4 Primary	1-1,000,000V
	V4 Secondary	1-1,500V
Measurement Category	CAT III 600V	
Frequency	40Hz-60Hz @ 50Hz, 48Hz-72Hz @ 60Hz	

Power Supply (L+, N-)	
Standard	95-250VAC/VDC ± 10%, 47-440 Hz
Optional	20-60VDC
Burden	< 7VA/10W @ 250VAC or 60VDC


Digital Inputs (DIC, DI1, DI2, DI3, DI4)	
Standard	Dry contact, 24VDC internally wetted
Sampling	1000Hz
Hysteresis	1ms minimum

Form A Relay Outputs (DO11, DO12, DO21, DO22)	
Type	Form A Mechanical Relay
Loading	5A @ 250VAC or 30VDC


Form C Relay Outputs (Alarm 1, 2, 3)	
Type	Form C Mechanical Relay
Loading	8A @ 250VAC or 24VDC

## Device Views


Unit: mm

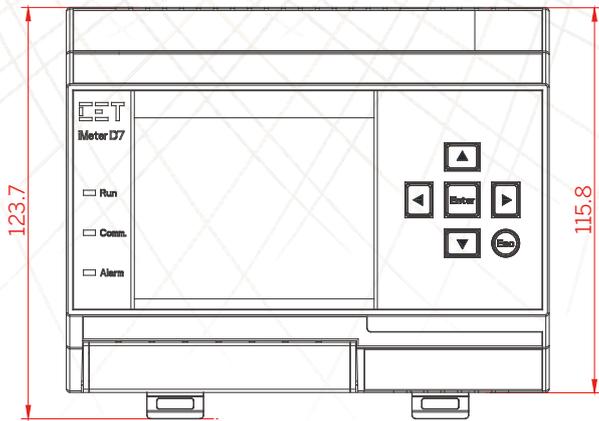

Front View

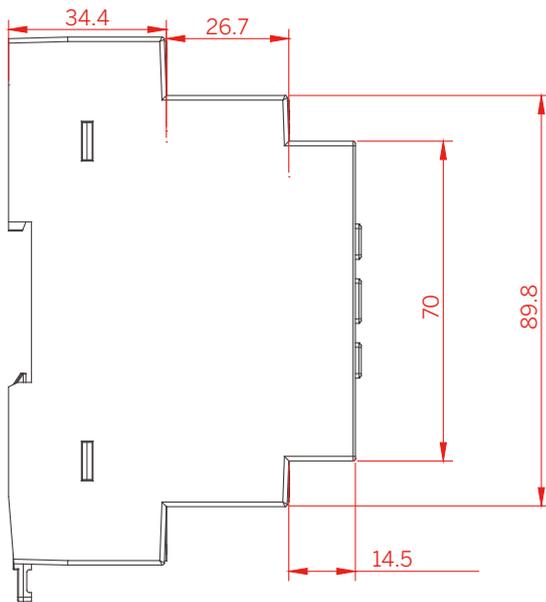

Side View

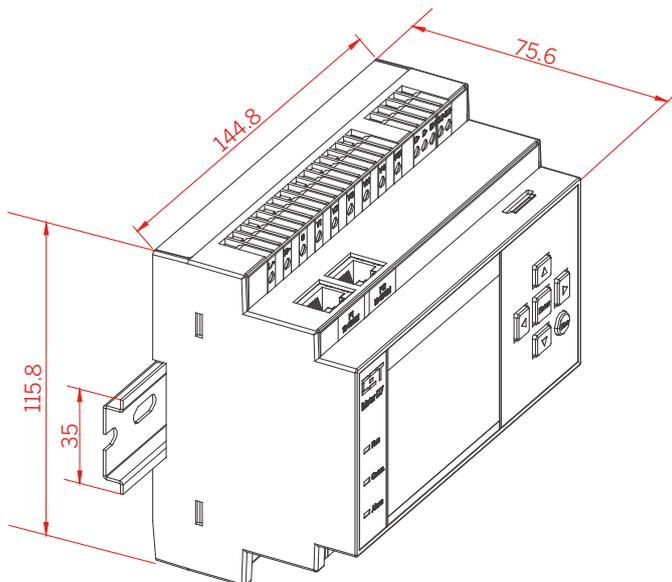

Installation

## Standards of Compliance

### Safety Requirements

CE LVD 2014/35/EU	EN61010-1: 2010 EN61010-2-030: 2010
Electrical Safety in Low Voltage Distribution Systems up to 1000Vac and 1500Vdc	IEC61557-12: 2021 (PMD)
Insulation AC Voltage: 2kV @ 1 minute Insulation Resistance: >100MΩ Impulse Voltage: 6kV, 1.2/50μs	IEC62052-11: 2003 IEC62053-22: 2003 EN61010-1: 2010

## EMC Compatibility

CE EMC Directive 2014/30/EU (EN61326: 2013)

### Immunity (EN50082-2)

Electrostatic Discharge	EN61000-4-2: 2009
Radiated Fields	EN61000-4-3: 2006 +A1: 2008 +A2: 2010
Fast Transients	EN61000-4-4: 2012
Surges	EN61000-4-5: 2014 +A1: 2017
Conducted Disturbances	EN61000-4-6: 2014
Magnetic Fields	EN61000-4-8: 2010
Voltage Dips and Interruptions	EN61000-4-11: 2004 +A1: 2017
Ring Wave	EN61000-4-12: 2017

### Emission (EN50081-2)

Limits and Methods of Measurement of Electromagnetic Disturbance Characteristics of Industrial, Scientific and Medical (ISM) Radio-Frequency Equipment	EN55011: 2016
Limits and Methods of Measurement of Radio Disturbance Characteristics of Information Technology Equipment	EN55032: 2015
Limits for Harmonic Current Emissions for Equipment with Rated Current ≤16 A	EN61000-3-2: 2014
Limitation of Voltage Fluctuations and Flicker in Low-Voltage Supply Systems for Equipment with Rated Current ≤16 A	EN61000-3-3: 2013
Emission Standard for Industrial Environments	EN61000-6-4: 2007 +A1: 2011

### Mechanical Tests

Spring Hammer Test	IEC62052-11: 2003
Vibration Test	IEC62052-11: 2003
Shock Test	IEC62052-11: 2003

### Power Quality

Voltage Characteristics of Electricity Supplied by Public Distribution Systems	EN50160: 2010
General Guide on Harmonic and Interharmonic Measurements and Instrumentation, for Power Supply Systems and Equipment Connected Thereto	IEC61000-4-7: 2009
Flicker Meter-Functional and Design Specifications	IEC61000-4-15: 2010
Testing and Measurement Techniques-Power Quality Measurement Methods	IEC61000-4-30: 2015 Ed.3 Class A Certified
Power Quality Measurement in Power Supply Systems-Part 2: Functional Tests and Uncertainty Requirements	IEC62586-2: 2017 Ed.2
Harmonic Control in Electrical Power Systems	IEEE Std 519-2022

# Ordering Guide

Product Code											Description	
iMeter D7 DIN-Rail Advanced Power Quality Analyzer											IEC61000-4-30 Ed. 3 Class A Certified with 2kHz-150kHz C.E. Measurements	
Basic Function	B											
Input Current	5										5A	
	1										1A	
	SCCT										For use with 100A/200A/400A/800A/1600A to 40mA SCCTs (SCCTs not included)	
	SCCTA										For use with 5A/2mA SCCTs (SCCTs not included)	
	SCCPA <sup>^</sup>										SCCP Option for use with CT Clamps with max. 500mV output (SCCPs not included)	
Input Voltage	9										400V <sub>LN</sub> /690V <sub>L-L</sub> + 20%	
Power Supply	2										95-250VAC/DC ± 10%, 47-440Hz	
	3*										20-60VDC	
System Frequency	5										50Hz	
	6										60Hz	
I/O	A										4xDI + 3xDO (Mechanical Relay)	
	B										4xDI + 3xSS Pulse Outputs	
Analog Inputs	X										None	
	A*										2xAI	
	B*										1xIr + 1xRTD	
Communications	A										2x10/100BaseT + 1xRS-485	
	B**										2x10/100BaseT + 1xRS-485 + 4G (CN Band)	
	C**										2x10/100BaseT + 1xRS-485 + 4G (EU Band)	
Display Language											E	English
iMeter D7	-	B	5	9	2	5	A	X	A	E	iMeter D7-B5925AXAE (Standard Model)	

\* Additional charges apply.

<sup>^</sup> The SCCPA option is compatible with the SCCT models listed in the "Optional SCCTs" table.

This option does not come with any Current Clamp. Please refer to the "Optional SCCTs" table for more information and order the desired model and quantity as a separate item.

# The 4G Modem for CN Band is only applicable to China area.

The 4G modem for EU Band supports the following Frequency Bands:

- 4G LTE: B1/B3/B5/B7/B8/B20/B28/B38/B40/B41
- 3G DC-HSPA+/HSPA/UMTS: B1/B5/B8
- 2G GSM: 900/1800 MHz

## Optional SCCTs


				
Model No.	PMC-SCCP-50A-500mV-B-A-B	PMC-SCCP-200A-200mV-B-B-B	PMC-SCCP-500A-500mV-B-B-B	* PMC-SCCP-5kA-500mV-B-C-C-371/254/150/100
Measurement Range	5A (50A I <sub>max</sub> )	20A/200A (200A I <sub>max</sub> )	500A (500A I <sub>max</sub> )	500A/5000A Rogowski Coil (5000A I <sub>max</sub> )
Max. Allowable Current	50A	260A	500A	10,000A
Output Voltage	AC 10mV/A (Max. 500mV)	AC 10mV/A @ 20A AC 1mV/A @ 200A (Max. 200mV)	AC 1mV/A (Max. 500mV)	AC 1mV/A @ 500A AC 0.1mV/A @ 5000A (Max. 500mV)
Accuracy	±0.3% rdg. ±0.02% f.s.	±0.3% rdg. ±0.02% f.s.	±0.3% rdg. ±0.02% f.s.	±2.0% rdg. (1% - 200%) I <sub>n</sub>
Protection	CAT III 300V	CAT III 600V	CAT III 600V	CAT III 1000V CAT IV 600V
Diameter	15mm	24mm	50mm	371/254/150/100 (mm)
Cable Length	3m	3m	3m	3m
Termination	BNC	BNC	BNC	BNC

\* The Rogowski Coil SCCT comes with an external Universal Power Supply and an integrator.

Email: sales@cet-global.com  
Website: www.cet-global.com

Copyright © CET Inc. All rights reserved.

Your Local Representative

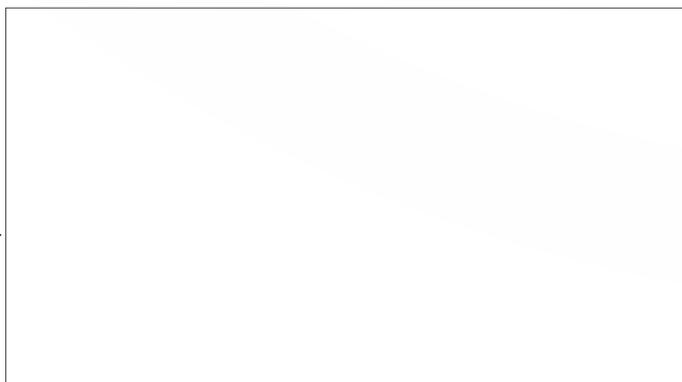

V.01 21.11.2024